


TWR024-036C100A TWR042C100B

TO POWER SUPPLY PER UNIT NAMEPLATE AND LOCAL CODES

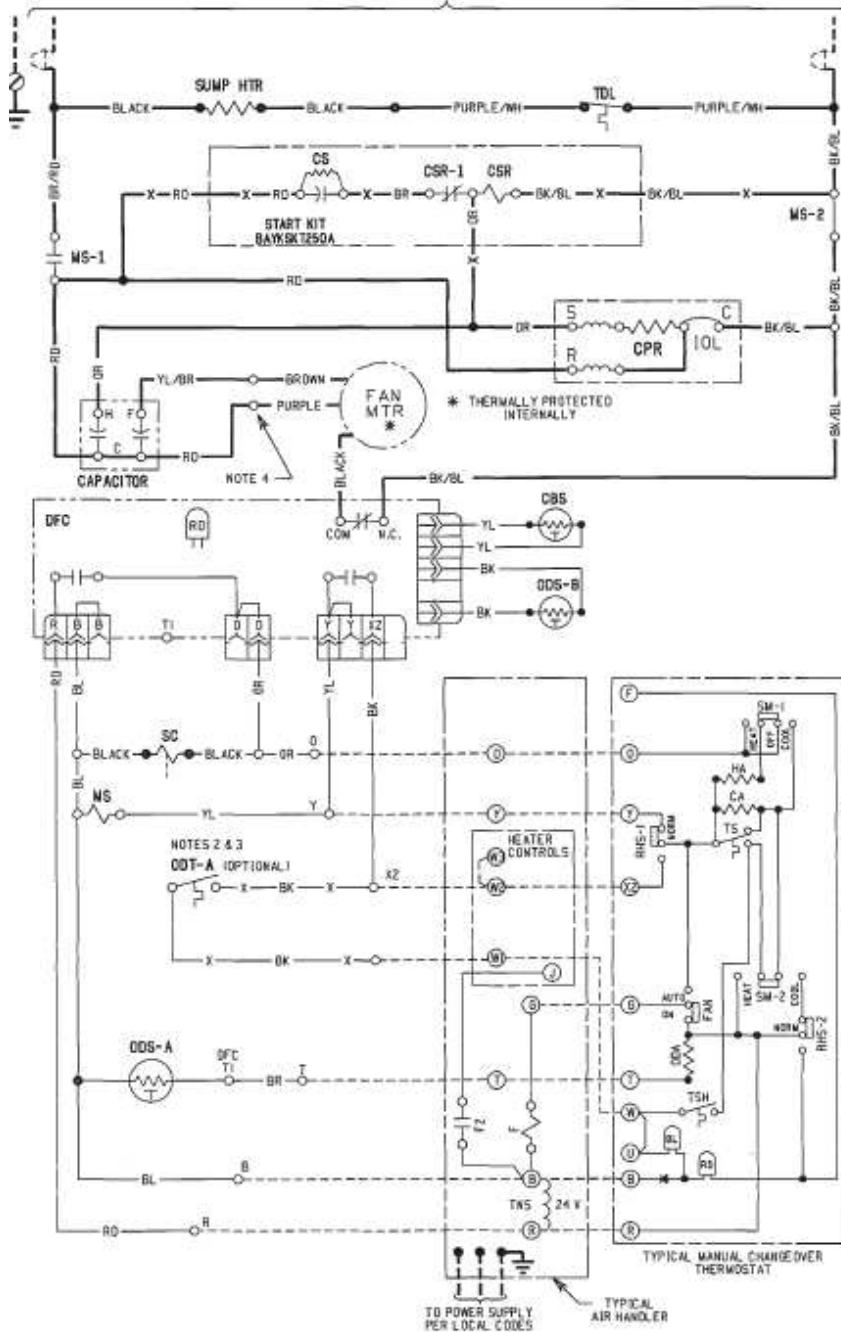

NOTES:

1. LOW VOLTAGE (24 V) FIELD WIRING MUST BE 18 A.W.G. MIN.
2. IF ODT-A IS NOT USED MAKE NO CONNECTIONS TO BK LEADS AT OD UNIT AND ADD JUMPER BETWEEN W1 & W2 AT AIR HANDLER.
3. OPTIONAL ODT NOT AVAILABLE IN ALL MODELS.
4. SOME MODELS HAVE THE MOTOR LEADS CONNECTED DIRECTLY TO THE CAPACITOR/CONTACTOR.