


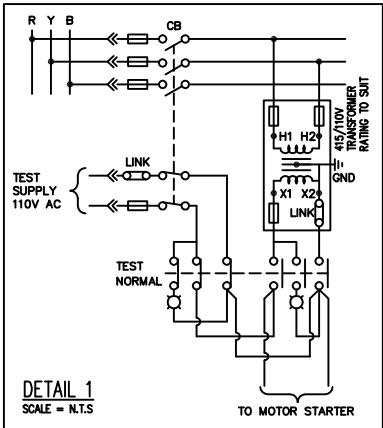

SCHEDULE FOR AMMETERS				
MOTOR RATING (OUTPUT) KW 1500 rpm (415V)	STARTER	ESTIMATED FLC	SCALE FOR AMMETER	THERMAL OVERLOAD RANGE
1.5	DOL	3.4	0-5...25	3 - 5A
2.2	DOL	4.7	0-5...25	4 - 6.2A
3.8	DOL	7.9	0-20...100	6 - 9.2A
15	DOL	28.1	0-50...250	22 - 32A
20	DOL	35.9	0-80...300	30 - 45A
30	DOL	53.6	0-100...500	42 - 63A
90	AT	154.3	0-250...1250	NOT APPLICABLE
225	AT	378	0-600...3000	NOT APPLICABLE
315	AT	496	0-800...4000	NOT APPLICABLE
HEATER RATING KW	SCALE FOR AMMETER			
2	0-5...10			
50	0-100...200			
75	0-150...300			
150	0-300...600			

NOTE :

1.) ALL CURRENT TRANSFORMER FOR AMMETER SHALL BE RATED AT 5A SECONDARY UNLESS SPECIFIED OTHERWISE IN DRAWING.

2.) PRIMARY CURRENT RATING OF CURRENT TRANSFORMER FOR AMMETER SHALL MATCH AMMETER SCALE FOR DIRECT READING.

